



OPERATING MANUAL

Ver.3.0

01

Monitor Main

- full duplex
- touch Screen
- rechargeable batteries



02

Main Icon



Unit Power on / off



Wireless Status
transmission



Wireless Status
wireless receiving



Water Level



Manual Mode



Timer (Schedule) Mode



Auto Mode

If missing a remote monitor, there is a auto mode switch in a control box of the unit. The unit will be drive on cool mode / 23°C / everyday.



Remote Switch off
Check Remote cable.



Filter Clean Alarm



Sensor Check
Temp sensor or CT sensor.



Battery

03

Main Icon



Temp | Up · Down



Fan Speed | High · Low



Cool Mode | On · Off



Heat Mode | On · Off(OPTION)



Main



Date | Time | Timer Setting (Week and three times a day)



Timer On · Off | Option setting

If selecting Timer On, Schedule mode  is expressed on the screen.



Status of Unit System

version / voltage / current / Temp

Date | Time

touch ↓

Current date
and time iconCurrent date
and time2017^{MON}
06/15
15:00Date | Time

touch ↓

date
settingYear, Month, day
(Auto day of the week)2017 ▾
06 ▾
15 ▾Date | Time

touch ↓

time
setting


Hour, Min, Sec

13 ▾
05 ▾
50 ▾


05

Timer (Schedule) Mode

Date | Time
touch ↓



Timer (Schedule)
Mode



요일 선택


SUN	08 : 00 00 : 00
MON	08 : 00 20 : 00 [COOL]
TUE	08 : 00 20 : 00 [COOL]
WED	08 : 00 20 : 00 [COOL]
THU	08 : 00 20 : 00 [COOL]
FRI	08 : 00 20 : 00 [COOL]
SAT	00 : 00 00 : 00

Time, Mode, Fan speed, temp

[-]	[+]	08 : 00	[+]	[-]	
[-]	[+]	20 : 00	[+]	[-]	
냉방		고속	23	[+]	[-]


mon

! Monday ~ Friday | 08hr ~ 20hr | COOL | 23°C | High Fan
CHECK BOX ON - TIMER OPERTAION

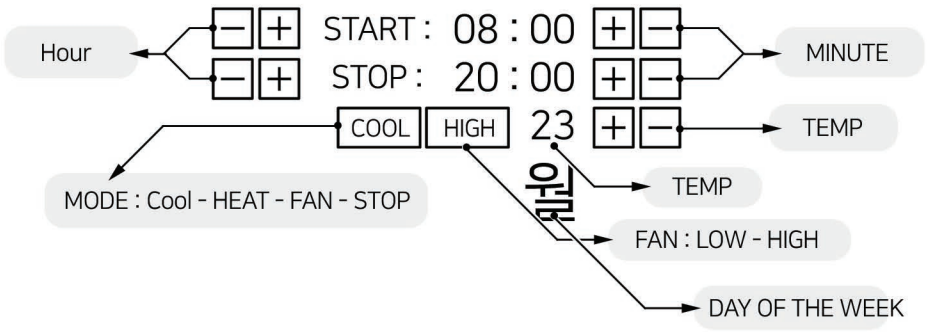

TIMER ON · OFF | OPTION SETTING

TIMER
TIMER OPERATION



OPTION


SELECT TIMER
(CHECK BOX)

TIMER OPERA

절전 냉방


UV 램프

MAIN SCREEN



SCHEDULE MODE

ECHO COOL MODE
ECHO POWER SAVING



OPTION


SELECT ECHO POWER
(CHECK BOX)

빅크 고온


POWER SAVI

UV 램프

SAVING
POWER OF
COMPRESSOR



OPTION
UV | AIR



OPTION

SELECT OPTION
(CHECK BOX)

UV LAMP

IONIZER

UV LAMP
UV-C type
air sterilization



IONIZER
air sterilization



(OPTION)

07

SYSTEM | CLEAN FILTER




SYSTEM

01. VERSION
02. ID
03. MODE
04. CURRENT
05. TYPE
06. FILTER RUN-TIME
07. FILTER TO CLEAN
08. FILTER RESET
09. NTC STATUS
10. C/T STATUS

<CLEAN FILER>

If filter is full of dust, evaporator will be frozen.

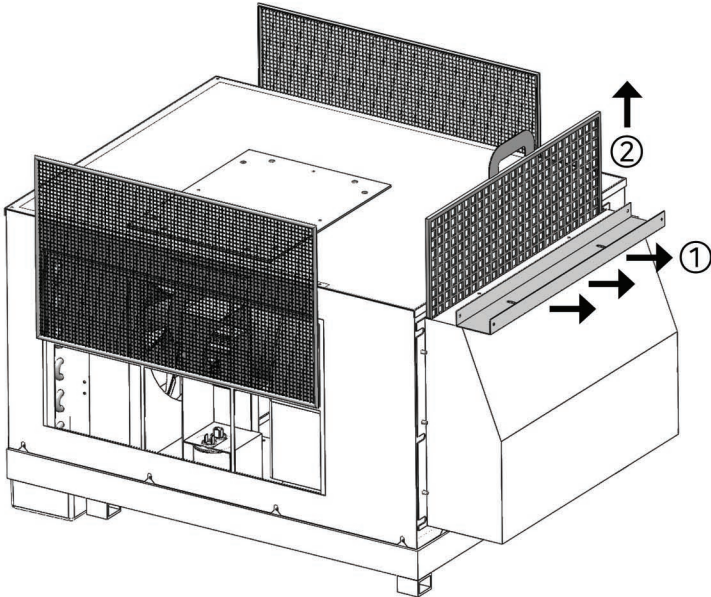

To read the instruction manual carefully to avoid the fault of unit.

Use exclusive circuit breaker and electric leakage interrupter according to installation conditions.

Do grounding properly.

Do not disassemble, repair or remodel.

Do not step on or put heavy material on unit.


after switching off the power and stopping fan operation ,Start cleaning.

clean air filter once in 4weeks.

Make inquiries to supplier, you should switch off power immediately, if there is any strange noise, burning smell or smoke found in operation.


(It may cause danger of electric shock and fire)

Do not give severe shock to remote monitor or disassemble it.

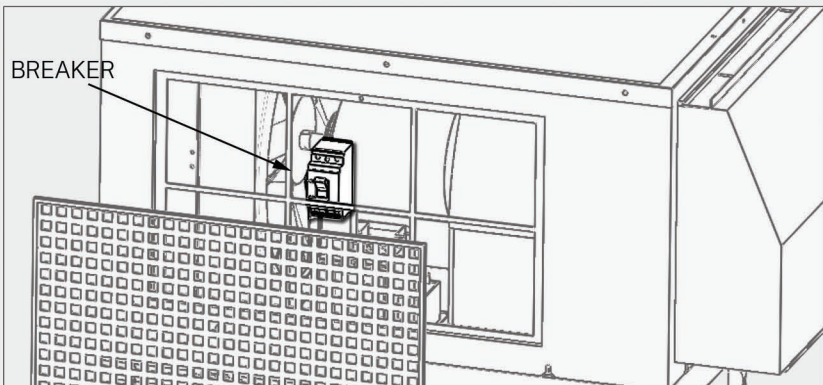

09

NAME OF PARTS

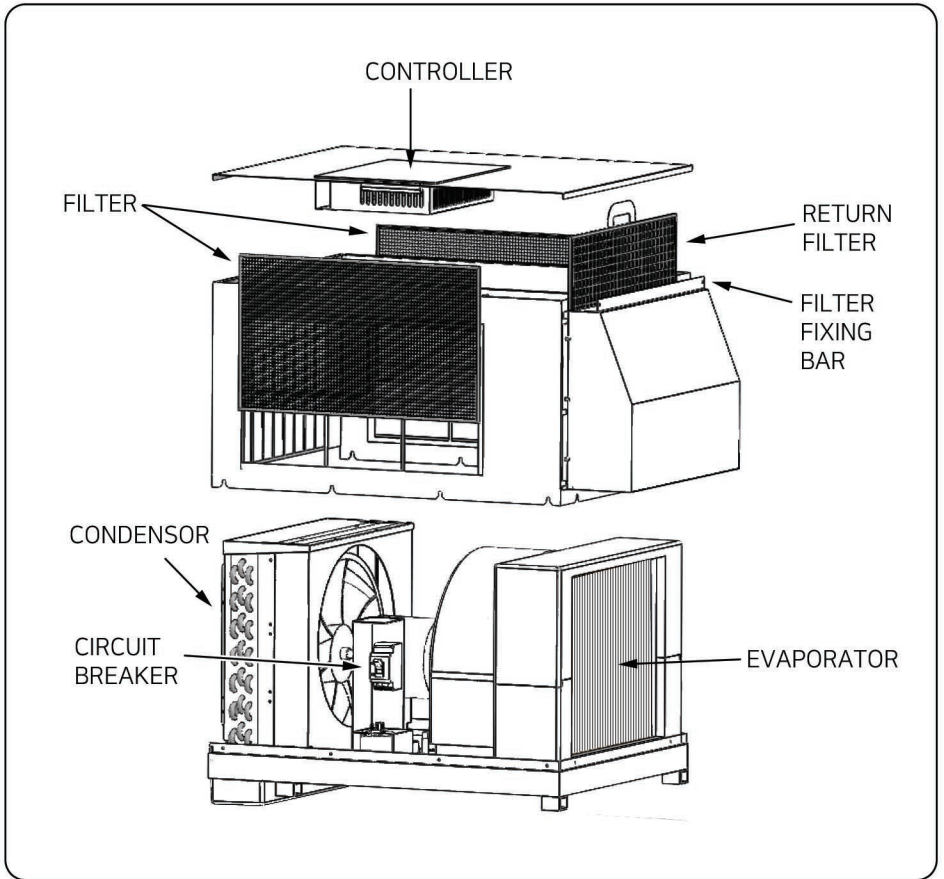

MAINTENANCE | WARRANTY

ITEMS	MAINTENANCE PERIOD
CLEANING FILTER (3EA)	ONCE A MONTH
EVAPORATOR COIL (REMOVE DUST)	MORE THAN ONCE A YEAR
CHECK Control Kit	ONCE PER 3 YEARS

WARRANTY

- This product is assumed the responsibility from our company in all route.
- This product is accepted by technical team who has a strict and close inspection test.
- Under the terms of the warranty, a product found to have defects due to poor quality materials or substandard workmanship will be replaced.

<BREAKDOWN FROM NORMAL STATUS>

WARRANTY PERIOD : PEPAIR FREE

NON-WARRANTY PERIOD : REPAIR AT A COST

<BREAKDOWN FROM CONSUMER STATUS>

WARRANTY PERIOD : REPAIR AT A COST

NON-WARRANTY PERIOD : REPAIR AT A COST

NON-FREE SERVICES

1.Not breakdown

(First of all, please read the user manual. If not breakdown and ask our s evices, it is caused a cost.)

- To impede unit ability from dust obstruction of filter coils.
 - Ice stack in evaporator coil lateral
- (please refer page 23 'Checklist before contacting a/s'.)

2.Breakdown from consumer

- unit remodeling illegal
- Incorrect electric power using(ex. 220v-110v)
- repair from unidentifiable person not our company.

3.etc

- Filter clean or coil dust clean
- product re-install
- breakdown from natural disaster

캐리어 에이피에이(주)
+82-31-404-0710
CARRIERAPA.COM